




Granulats : GRAVILLON 12,50/20 ROULE LAVE
Péetrographie : Silico-Calcaire
Elaboration : Roulé Lavé
Usage : Bétons hydrauliques

Classe granulaire		Partie contractuelle						Catégorie	
12.5 / 20		Norme NF P 18-545 Article 10						Code A	
		d/2	d	D	1.4D	2D	FI	W	
		0.063	6.3	12.5	20	28	40		
Etendue e			15	15					
V.S.S.+U	1.8	6	20	100			24.00		
V.S.S.	1.5	5	15	99			20.00		
V.S.I.			0	84	98	100			
V.S.I.-U			0	79	97				

Partie informative								
Résultats de production								
du 15/04/24 au 03/12/24								
	0.063	6.3	12.5	20	28	40	FI	W
Maximum	0.5	1	8	93	100	100	11.50	1.8
Moyenne Xf	0.3	1	6	92	100	100	8.24	1.5
Minimum	0.2	0	4	90	100	100	7.00	1.2
Ecart-type	0.09	0.1	1.2	0.7	0.0	0.0	1.666	0.10
Nombre de résultats	21	21	21	21	21	21	5	21

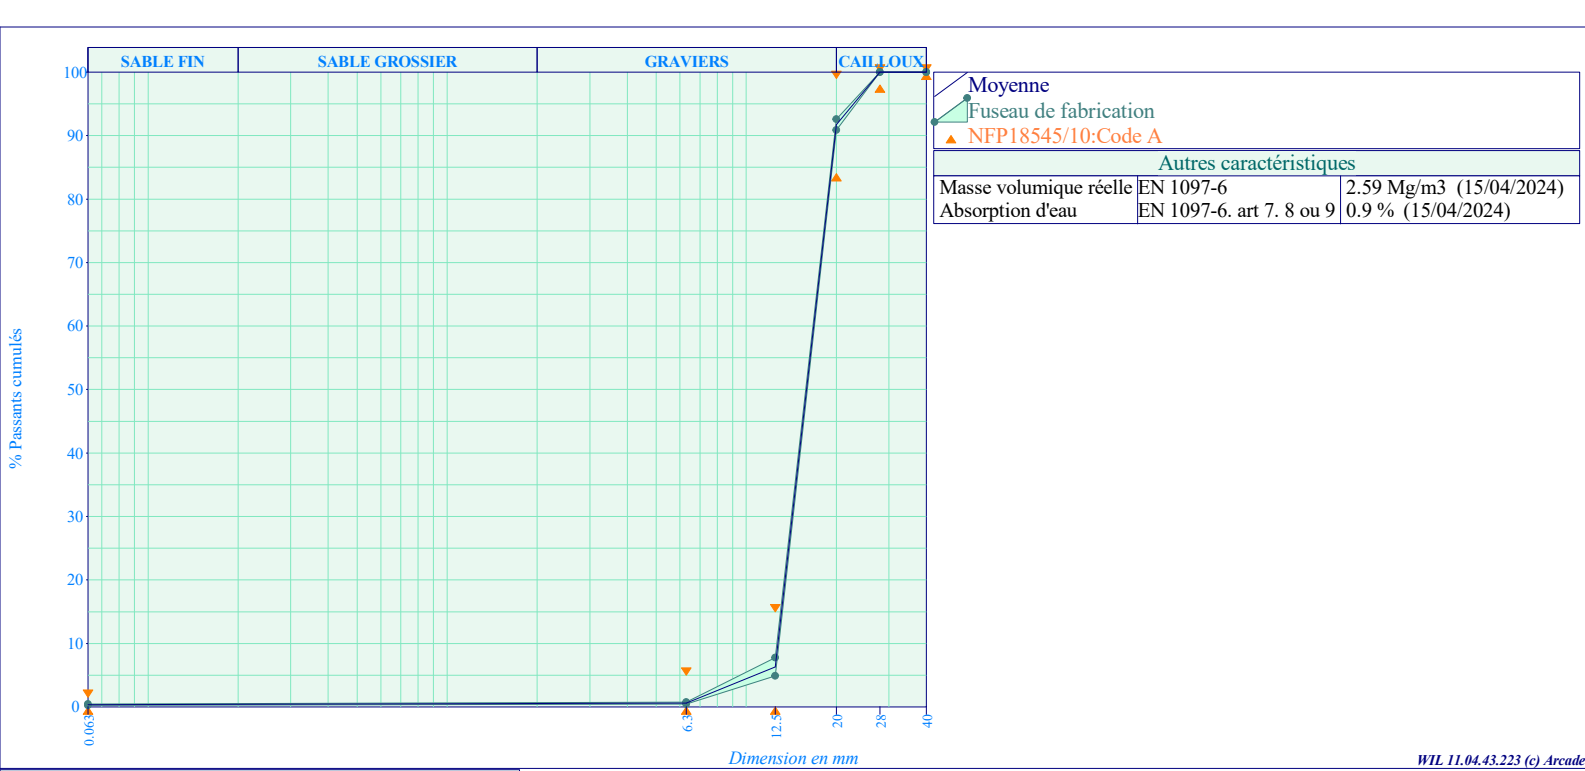

DRUET Marion Responsable QSE